

ExCos-D Transducer for ExPro-C.. sensors (probes) ExPro-C.. Temperature-/humidity sensors (°C, %rH)

Electrical, explosionproof transducer only connectable for **ExPro-C..** temperature and humidity sensors.

24 VAC/DC supply, 0...10 V / (0) 4...20 mA output

PTB-certified in acc. with ATEX directive 94/9/EC for zone 1, 2, 21, 22.

Type of transducer:
ExCos - D
ExCos - D - A
ExCos - D.. - CT
Type of sensor (probe):
ExPro - CT...
ExPro - CF...
ExPro - CTF...

Subject to change!

Transducer


Type	supply	installation area	connectable sensors	function of sensors	sensor connection	wiring
ExCos - D	24 VAC/DC	zone 1, 2, 21, 22	ExPro-CT..., ExPro-CF..., ExPro-CTF..	°C, %rH, combination °C/%rH	via plug-and-socket connection	SB 2.0
ExCos - D - A	as above, but with additional intrinsically safe analogue output to connect an external digital indicator(0) 4...20 mA (Ex-i)					SB 3.0
ExCos - D..- CT	Type as above but with aluminium housing and amercoat painting (sensor connection cable glands nickel-plated, screws in stainless steel)					

Connectable sensors (compulsory for ExCos-D.. transducer) – have a look on separate data sheet

Type	function	measuring range	length of sensor	connectable to	installation sensor	installation transducer
ExPro - CT...	temperature	-40...+125 °C*	50/100/150/200 mm	ExCos-D..., RedCos-D..	zone 1, 2, 21, 22	zone 1, 2, 21, 22 (ExCos...)
ExPro - CF...	humidity	0...100 %rH	50/100/150/200 mm	ExCos-D..., RedCos-D..	zone 1, 2, 21, 22	zone 1, 2, 21, 22 (ExCos...)
ExPro - CTF...	combination temp./humidity	-40...+125 °C*/0...100 %rH	50/100/150/200 mm	ExCos-D..., RedCos-D..	zone 1, 2, 21, 22	zone 1, 2, 21, 22 (ExCos...)

* at 50 mm length -40...+80 °C sensor length

Application

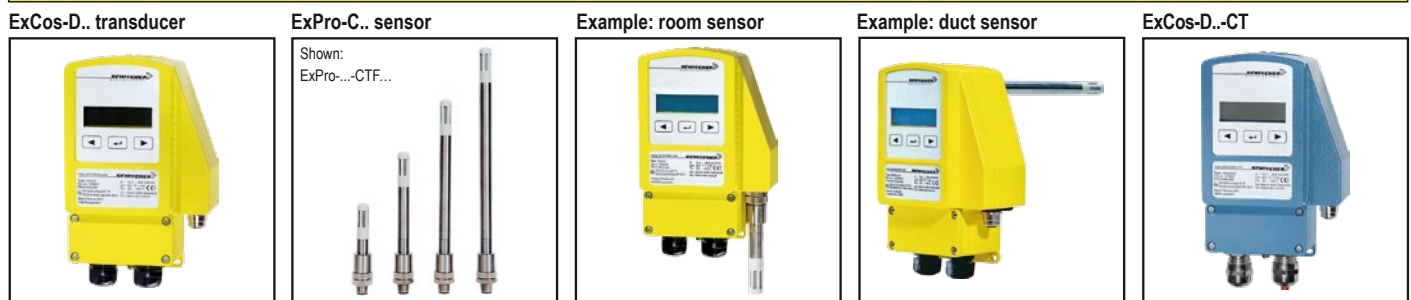

Description

The new **ExCos-D...** transducer generation from together with direct coupled **ExPro-C.. sensors** are a revolution for measuring temperature and/or humidity in HVAC systems, in chemical, pharmaceutical, industrial and Offshore-/Onshore plants, for use in hazardous areas zone 1, 2 (gas) and zone 21, 22 (dust).

Highest protection class (ATEX) and IP66 protection, small dimension, universal functions and technical data guarantee safe operation even under difficult environmental conditions.

The measuring ranges are scalable within the maximum ranges. The analogue output signal is either 0...10 VDC or 4...20 mA and can be selected on site. The integrated display is for actual value indication which can be switched off.

All sensors are programmable on site without any additional tools.

ExCos-D-A transducer are additionally equipped with a 4...20 mA IS (IS = intrinsically safe) output, e.g. for an external indicator.

Highlights transducer

- ▶ For all type of gas, mixtures, vapours and dust for use in zone 1, 2, 21 and 22
- ▶ No additional Ex-i module required
- ▶ No intrinsically safe wiring/installation between panel and sensor required
- ▶ No intrinsically safe wiring/installation and no space in the panel required
- ▶ Integrated Ex-e junction box
- ▶ Power supply 24 VAC/DC
- ▶ Display with backlight, can be switched off
- ▶ Scalable analogue output, selectable 0...10 V / (0) 4...20 mA
- ▶ Compact design and small dimension (L × W × H = 180 × 107 × 66 mm)
- ▶ Robust aluminium housing in protection class IP66
- ▶ Down to -20°C ambient temperature applicable
- ▶ Password locking
- ▶ Optional IS-output (4...20 mA) for external indicator in Ex-areas
- ▶ CT versions have an excellent resistance to chemicals and sea water

Highlights sensor

- ▶ For all type of gas, mixtures, vapours and dust for use in zone 1, 2, 21 and 22
- ▶ Plug-and-socket connection to ExCos-D... transducer, removable
- ▶ The ExPro-C.. probe appropriates the function (temperature, humidity or combination)
- ▶ Mounting of ExPro-C.. probe (front/back side) appropriates use for duct or room application

Technical data	ExCos-D...
Power supply	24 VAC/DC \pm 20% (19,2 ... 28,8 VAC/DC) 50..60 Hz
Current, power consumption	150 mA, ~ 4 W, internal fuse 500 mA, without bracket, not removable
Galvanic isolation	supply – analogue output 1,5 kV (Ex 60 V)
Electrical connection	terminals 0,14...2,5 mm ² at integrated Ex-e junction box
Cable entry	M16 \times 1,5 mm Ex-e approved, cable diameter ~ \varnothing 5...10 mm, (...CT in nickel-plated)
Protection class	Class I (grounded)
Display	2 \times 16 digits, dot-matrix with backlight, display for configuration, user guidance, parameter and actual value indication
Control elements	3 buttons for configuration
Housing protection	IP66 in acc. to IEC 60529
Housing material	aluminium casting, coated (...CT = version in marine painting, seawater-resistant)
Dimensions/weight	L \times W \times H = 180 \times 107 \times 66 mm / ca. 950 g
Ambient temperature/-humidity	-20...+50 °C / 0...95 %rH, non condensed
Storage temperature	-40...+70°C
Sensor connection	only for ExPro-C.. sensors! via plug-and-socket connection at front or back side of the transducer, to appropriate the use for room or duct mounting. Attention: only one ExPro-C.. probe can be connected to one transducer!
ExPro-C.. sensors	please have a look on the separate data sheet for ExPro-C.. sensors
Measuring range	measuring ranges are scalable within the maximum measuring range
Maintenance	maintenance free, nevertheless maintenance must be complied with regional standards, rules and regulations
Response time of sensor	T90 ~ 1 s
Accuracy temperature	\pm 0,2 % of end value + accuracy of ExPro-C.. sensor \pm 0,3 °C at 25 °C \pm 0,025 °C/°C
Accuracy humidity	\pm 0,2 % of end value + accuracy of ExPro-C.. sensor 10...90 %rH \pm 2% and < 10 %rH and > 90 %rH \pm 4%
Non linearity and hysteresis	\pm 0,1 % (\pm 0,1 % of end value + accuracy of ExPro-C.. sensor)
Start delay	5 s
Stability	long term stability < 0,2 %/year, temperature influence < 0,02 %/K, supply voltage influence < 0,01 %
Output	voltage U(V) or current I(mA) selectable via menu on site (at combi sensors not separately adjustable)
Output protection	against short circuit and external voltage up to 24 V, protected against polarity reversal
Voltage output U	from 0...10 VDC adjustable, invertible, burden > 1 k Ω , influence < 0,05% / 100 Ω
Current output I	from 0...20 mA adjustable, invertible, burden < 500 Ω , influence < 0,1% / 100 Ω , open circuit voltage < 24 V
Output at alarm mode	increasing or decreasing output signal, selectable on site, down to 0 VDC/0 mA or up to 10 VDC/20 mA
Wiring diagram (SB)	SB 2.0
Delivery (changeable on site)	output 4...20 mA, output with decreasing alarm situation to 0 V/0 mA
Included in delivery	ExCos-D.. with 3 screws 4,2 \times 13 mm self-tapping
Installation area transducer	in Ex-area zone 1, 2, 21, 22
Additional information for ExCos-D-A:	
Analogue output	(0) 4...20 mA
Ex-i	Intrinsically Safe (IS)
Burden	max. 400 Ω
Accuracy	\pm 0,5 %
Plug	cable diameter \varnothing 6...8 mm
Delivery version ... -D-A	incl. 2 \times plug


Explosion proof	ExCos-D...
PTB-testet	PTB 07 ATEX 2061
acc. to ATEX directive	RL 94/9/EC (ATEX)
Approval for gas	I12(1)G Ex e ma [ia] IIC T6 for zone 1, 2
Approval for dust	I12(1)D Ex tD A21 [iaD] IP66 T80°C for zone 21, 22
Identification	CE Nr. 0158
EMC	2004/108/EC EMC directive
Electrical safety	2006/95/EC low voltage directive
Protection type	IP66 in acc. to EN 60529
Potential compensation	external PA-terminal, 4 mm ²

Accessories	
EXC-RIA-261	LCD indicator (IS), installation in Ex-areas zones 1, 2, 21, 22, connectable direct to Ex-/RedCos-D..-A transducer
MKR	Mounting bracket for round ducts up to \varnothing 600 mm
MFK	Mounting flansh for probe positioning

Electrical wiring

ExCos-D... transducer required a 24 VAC/DC power supply. The supply has to be connected at terminal 1 (-/~) and 2 (+/~), the analogue output at terminal 3 (mAV) and 4 (GND) for temperature, at terminal 5 (mAV) and 4 (GND) for humidity. The electrical wiring must be realized via integrated Ex-e junction box in acc. to ATEX. Type of protection for the terminals is "Ex-e". **Attention!** Before opening the junction box cover, the supply voltage must be shut off! The optional analogue output at **ExCos-D-A** is intrinsically safe. Note the maximum connection values of intrinsically safe parameters (see table below).

Wiring diagram ExCos-D...

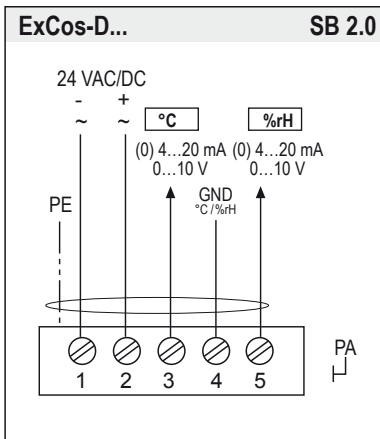

In acc. to the connected **ExPro-C.. sensor** you get output signals at following terminal:
sensor terminal terminal
 ExPro-CT... 3 - 4
 ExPro-CF... 4 - 5
 ExPro-CTF... 3 - 4 und 4 - 5


It's either output mA or V adjustable.

Attention !
Humidity output below 0 °C no function

Parameter

Before starting parametrisation of **ExCos-D..** transducer an **ExPro-C..** sensor must be connected. ExPro-C.. sensors are available as ExPro-CT.. for single temperature measurement, as ExPro-CF.. for single humidity measurement and as ExPro-CTF.. for combined measurement of temperature and humidity. All types are connectable to an ExCos transducer but only one sensor to one transducer. In acc. with the sensor type you need to set parameter for one or two measuring ranges.

Display and Buttons

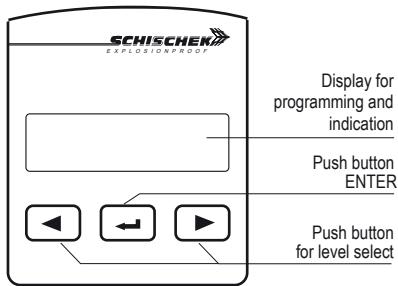



Change operation-/parametrisation mode

To change from operation to parametrisation mode and vice versa, push the enter button for minimum 3 seconds.

Indication of data logging

A blinking star in the display shows that datas received and the device is working.

Wiring Ex-i output (optional) at ExCos-D...A transducer

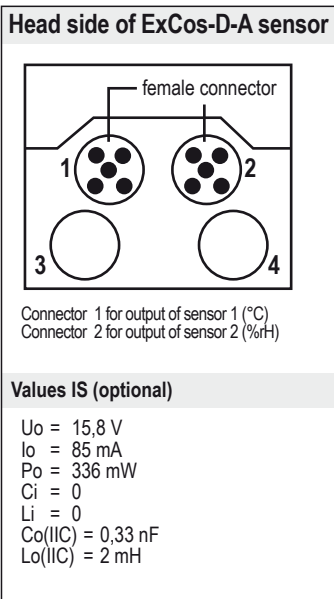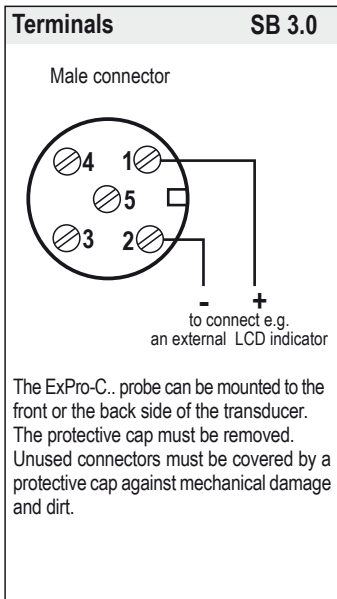


Password input

The default/delivery setup is **0000**. In this configuration the password input is not activated. To activate a password, go to menu point 20, change the 4 digits into your choosen numbers (e.g. 1234) and press Enter. **Please keep your password in mind for next parameter change!** Due to a new parameter setup the password is requested.

Important information for installation and operation

- A. Installation, Commisioning, Maintenance**
 The cable has to be drawn through the cable gland. After electrical connection the cable gland must be fixed tight. IP66 must be fulfilled. In acc. with operation ExCos sensors are maintenance free. Nevertheless maintenace must comply with regional standards, rules and regulations. The sensors must not be opened by the customer. For outdoor installation a protective housing against rain, snow and sun should be applied. For electrical connection use the internal approved Ex-e junction box. **Attention:** Note the explosion proof rules before opening the internal junction box. Cut off the power supply.
- B. ExPro-C.. sensors**
 ExPro-C.. sensors are supplied with an intrinsic safe circuit from the ExCos-D.. transducer. Unused connectors must be covered by a protective cap.
- C. Long cabling**
 For using long signal wires, shielded cables are recommended. The shield must be connected to the ExCos-D transducer inside the terminal box.
- D. Separate ground wires**
 Use for supply and signal wires a separate ground.

Dimensions / Drillings

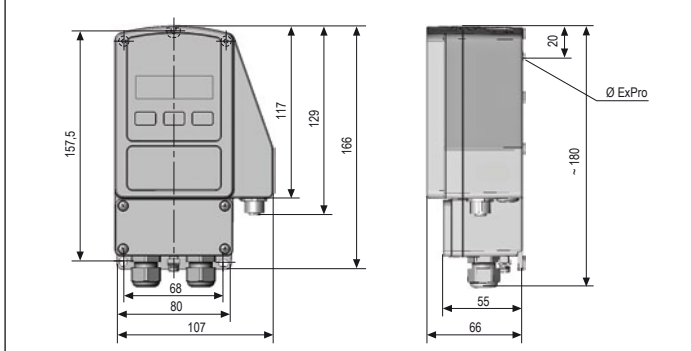



Values intrinsically safe (IS) for ExPro-C.. sensors

Digital ExPro-C.. sensor

Uo = 7,9 V
 Io = 48 mA
 Po = 95 mW
 Ci = 0
 Li = 0
 Co(IIC) = 1,3 nF
 Lo(IIC) = 2 mH


Parametrisation and commissioning of ExCos-D (-A) transducers after an ExPro-C.. sensor ist connected

Preparation of parametrisation/operation

Operation ↔ Parametrisation, push  for 3 sec.
If password (PW) protection is active: put PW in, push 



































































































































Change operation-/parametrisation mode

To change from operation to parametrisation mode push "enter button"  for minimum 3 seconds. Back over the menu save and exit.

Example of parameters

Language english
Range 0...+50 °C, 0...100 %rH
Output each 0...10 VDC, 0...20 mA
Outputs Ex-i 4...20 mA

Menu	Function	Enter	Indication	Select	Enter	Next indication	Next selction	Enter	Next menu
Menu 1	DE, EN, FR select language: german, english, frensh		DE, EN, FR english deutsch, english, francais	 					
Menu 2	no function - menu skip								
Menu 3	no function - menu skip								
Menu 4	unit sensor 1 select physical unit		unit sensor 1 °C °C, °F	 					
Menu 5	range 1 adjust the measuring range		range 1 0..50 °C ↑ adjust lower limit	 		range 1 0..50 °C ↑ adjust higher limit	 		
Menu 6	no function - menu skip								
Menu 7	output V, mA select output signal as VDC or mA		output V/mA V mA, V	 					
Menu 8	output range 1 adjust the output range		output range 1 0..10V ↑ adjust lower limit	 		output range 1 0..10V ↑ adjust higher limit	 		
Menu 9	sensor error 1 select signal at sensor error		sensor error 1 10V / 20 mA 10V / 20 mA or 0V / 0mA	 					
Menu 10	output 1   select if signal output is increasing or decreasing		output 1   increasing   increasing, decreasing	 					
Menu 11	unit sensor 2* select physical unit		unit sensor 2 %rH %rF, %rH	 					
Menu 12	range 2* adjust the measuring range		range 2 0..100 %rH ↑ adjust lower limit	 		range 2 0..100 %rH ↑ adjust higher limit	 		
Menu 13	output range 2* adjust the output range		output range 2 0..10V ↑ adjust lower limit	 		output range 2 0..10V ↑ adjust higher limit	 		
Menu 14	sensor error 2* select signal at sensor error		sensor error 2 0V / 0 mA 10V / 20 mA or 0V / 0mA	 					
Menu 15	output 2*   select if signal output is increasing or decreasing		output 2   increasing   increasing, decreasing	 					
Menu 16	output Ex-i 1 (option, only at ExCos-D-A) adjust 4...20 mA or 0...20 mA IS output signal		output Exi 1 4..20 mA ↑ adjust lower limit	 		output Exi 1 4..20 mA ↑ adjust higher limit	 		
Menu 17	output Ex-i 2 (option, only at ExCos-D-A)* adjust 4...20 mA or 0...20 mA IS output signal		output Exi 2 4..20 mA ↑ adjust lower limit	 		output Exi 2 4..20 mA ↑ adjust higher limit	 		
Menu 18	no function - menu skip								
Menu 19	display function select display on/off, illuminated or backlight off		display function on illuminated on-illuminated, on, off	 					
Menu 20	password select password protection		new password yes no	 		password 0000	 		
Menu 21	save and exit select save data / factory setting / discard or back to menu		save and exit save data	 					
Menu 22	Set offset 1 Add / subtract from measures value		set offset 1 0.00°C	 					
Menu 23	Set offset 2 * Add / subtract from measures value		sett offset.2 0.00%rH	 					

*only available if comibantion sensor type ExPro-CTF.. is connected



ExPro-C.. Digital Temperature-/Humidity Probe

Explosion proof digital probe exclusive connectable to ExCos-D / RedCos-D transducer for temperature and/or humidity measuring PTB-certified acc. to ATEX directive 94/9/EC for Zone 1, 2, 21, 22.

ExPro - CT...
ExPro - CF...
ExPro - CTF...

Subject to change!

Type/Probe	Function	Range	Sensor length	Applicable to transducer	Hazardous area
ExPro - CT...	Temperature Probe	-40...+125 °C*	50/100/150/200 mm	ExCos-D..., RedCos-D..	Zone 1, 2, 21, 22
ExPro - CF...	Humidity Probe	0...100 %rF	50/100/150/200 mm	ExCos-D..., RedCos-D..	Zone 1, 2, 21, 22
ExPro - CTF...	Combi Probe	-40...+125 °C* / 0...100 %rF	50/100/150/200 mm	ExCos-D..., RedCos-D..	Zone 1, 2, 21, 22


* at 50 mm length -40...+80 °C

Application

ExPro-C.. sensors 	Application Room 	Application Duct 	Accessory cable extension VL3 	
------------------------------	-----------------------------	-----------------------------	--	--

Technical data

	ExPro-CT...	ExPro-CF...	ExPro-CTF...
Application for	Temperature Probe	Humidity Probe	Combi Probe Temperature and Humidity
Measuring Range	-40 °C...+ 125 °C	0...100 %rF	-40 °C...+125 °C / 0...100 %rF
Sensor type and length	ExPro-CT- 50 = 50 mm ExPro-CT-100 = 100 mm ExPro-CT-150 = 150 mm ExPro-CT-200 = 200 mm	ExPro-CF- 50 = 50 mm ExPro-CF-100 = 100 mm ExPro-CF-150 = 150 mm ExPro-CF-200 = 200 mm	ExPro-CTF- 50 = 50 mm ExPro-CTF-100 = 100 mm ExPro-CTF-150 = 150 mm ExPro-CTF-200 = 200 mm
Response time	T90 / 20 s	T90 / 4 s	T90 / 20 s, T90 / 4 s
Accuracy Temperature	± 0,3 °C at 25 °C ± 0,025 °C/°C + transducer		
Accuracy Humidity	± 2 % at 10 ... 90 %rF, ± 4% at < 10%rF and > 90%rF + transducer		
Protection class	IP66 acc. to IEC 60529		
Material thermowell, protection tube	Stainless steel 1.4305, at length 50 mm in plastic max. temperature 80°C (room temperature)		
Filter element	at humidity probe with plastic filter element pore size 100 µm		
Ambient temperature/-humidity	-40...+125 °C / 0...100 %rF		
Storage temperature	-40...+125 °C		
Delivery	1 ExPro-C..... probe with fast connection and gasket (EPDM) for duct installation		
Installation area probe	in Ex-area zone 1, 2, 21, 22		

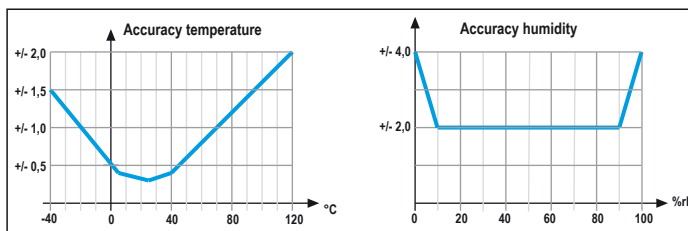

Medium temperature

Temperature class	T6	T5	T4	T3	T2	T1
Medium temperature max [°C]	59	74	109	125	125	125

The correlation of max. medium temperature and temperature class as well as the surface temperature is shown in table above.

Values intrinsically safe

U _i = 7,9 V	C _i = 0
I _i = 48 mA	L _i = 0
P _i = 95 mW	


Accessories

MFK	Flange for duct mounting, for variable depth of immersion in ducts
TH-VA	Immersion sleeve stainless steel V4A 1.4571, length 120 mm. other length on request
FA-VA	Filter element stainless steel, pore size 10µm not for high humidity!
MKR	Mounting bracket for duct Ø 600 mm
VL3	Cable extension 3 m, PVC

What is a ExPro-C.. probe ?

A ExPro-C.. probe is a sensor head resp. measuring element which is in combination with a ExCos-D transducer for temperature-, humidity or combi temperature/humidity measuring. ExPro-C.. probes are only for use with ExCos-D... transducer. The connection should be done with a socket on the front resp. on the back side of the transducer but only 1 ExPro-C.. module can be used.

Dimensions

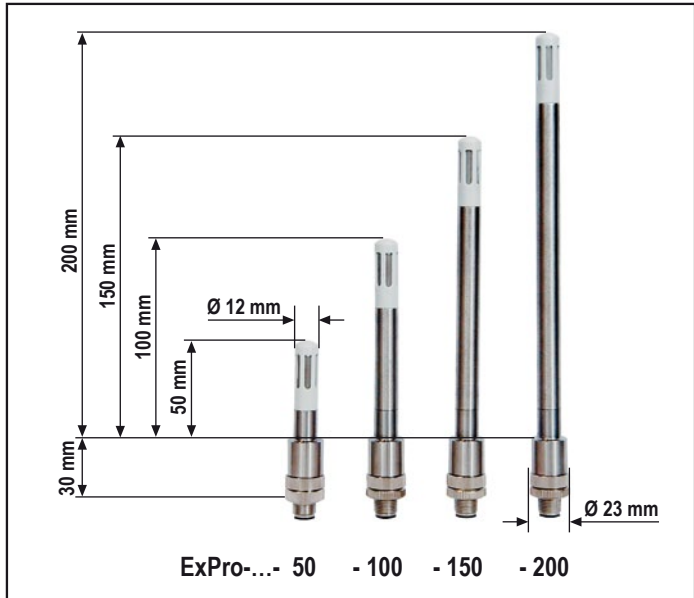


Important informations for installation and use

A. ExPro-C.. Probe
The power of the ExPro-C.. probe is supplied via an intrinsically safe (IS) circuit from the ExCos-D. Unused probe-entries at the ExCos-D have to be closed with the black caps.

B. Temperature-flow
In case of temperature measuring over the max. allowed environmental temperature of 50 °C of the transducer, it has to be watched, that no temperature flow over the probe takes place. The mounting of the probe has to make sure, that mistakes due to heat-dissipation are within the tolerance-limits and the max. allowed environment temperature is not exceeded.

C. Mounting
The probe is being screwed into the socket of the ExCos-D. The probe cannot be opened, as parts of the element are moulded. A small distance tolerance between ExCos-D (transducer) and ExPro-C.. (probe) has to be accepted due to production conditions.


Mounting duct probe (back side ..Cos-D)

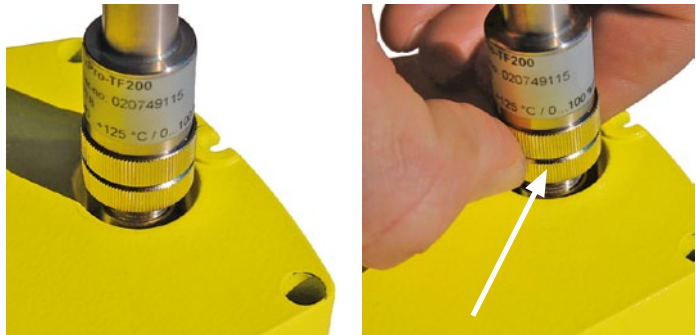

For mounting the probe plug the socket and screw on the sensor by turning the lower knurled thumb clock wise. Just screw hand tight. A small clearance between ExCos-D (transducer) and ExPro-C.. (probe) has to be accepted due to production conditions.

Mounting flange (MFK) for duct installation

The flange is moved over the probe and fix it with the side wise adjusting screw. The flange can be mounted with the 4 screws direct to the duct.

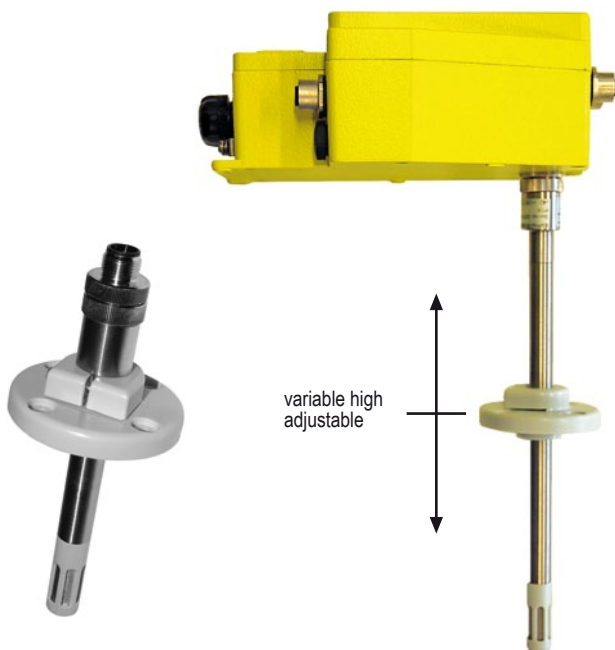

Mounting room probe (terminal box side ..Cos-D)



For mounting the probe plug the socket and screw on the sensor by turning the lower knurled thumb clock wise. Just screw hand tight. A small clearance between ExCos-D (transducer) and ExPro-C.. (probe) has to be accepted due to production conditions.